SIEMENS

Data sheet 3RT2016-1AP62



power contactor, AC-3e/AC-3, 9 A, 4 kW / 400 V, 3-pole, 220 V AC, 50 Hz / 240 V, 60 Hz, auxiliary contacts: 1 NC, screw terminal, size: S00

product brand name	SIRIUS
product designation	Power contactor
product type designation	3RT2
General technical data	
size of contactor	S00
product extension	
 function module for communication 	No
auxiliary switch	Yes
power loss [W] for rated value of the current	
 at AC in hot operating state 	0.9 W
 at AC in hot operating state per pole 	0.3 W
 without load current share typical 	4.4 W
insulation voltage	
 of main circuit with degree of pollution 3 rated value 	690 V
 of auxiliary circuit with degree of pollution 3 rated value 	690 V
surge voltage resistance	
 of main circuit rated value 	6 kV
of auxiliary circuit rated value	6 kV
maximum permissible voltage for protective separation between coil and main contacts according to EN 60947-1	400 V
shock resistance at rectangular impulse	
• at AC	6,7g / 5 ms, 4,2g / 10 ms
shock resistance with sine pulse	
• at AC	10,5g / 5 ms, 6,6g / 10 ms
mechanical service life (operating cycles)	
 of contactor typical 	30 000 000
 of the contactor with added electronically optimized auxiliary switch block typical 	5 000 000
of the contactor with added auxiliary switch block typical	10 000 000
reference code according to IEC 81346-2	Q
Substance Prohibitance (Date)	10/01/2009
Ambient conditions	
installation altitude at height above sea level maximum	2 000 m
ambient temperature	
 during operation 	-25 +60 °C
during storage	-55 +80 °C
relative humidity minimum	10 %
relative humidity at 55 °C according to IEC 60068-2-30 maximum	95 %
Main circuit	
number of poles for main current circuit	3

number of NO contacts for main contacts	3
operating voltage	
 at AC-3 rated value maximum 	690 V
at AC-3e rated value maximum	690 V
operational current	
 at AC-1 at 400 V at ambient temperature 40 °C rated 	22 A
value	
• at AC-1	
— up to 690 V at ambient temperature 40 °C rated	22 A
value	20.4
 up to 690 V at ambient temperature 60 °C rated value 	20 A
• at AC-3	
— at 400 V rated value	9 A
— at 500 V rated value	7.7 A
— at 690 V rated value	6.7 A
• at AC-3e	0.77
— at 400 V rated value	9 A
— at 500 V rated value	7.7 A
	6.7 A
— at 690 V rated value	
at AC-4 at 400 V rated value at AC-5 cup to 600 V rated value	8.5 A
at AC-5a up to 690 V rated value	19.4 A
at AC-5b up to 400 V rated value	7.4 A
• at AC-6a	
— up to 230 V for current peak value n=20 rated value	5.3 A
— up to 400 V for current peak value n=20 rated value	5.3 A
 up to 500 V for current peak value n=20 rated value 	5.3 A
 up to 690 V for current peak value n=20 rated value 	5 A
• at AC-6a	
 up to 230 V for current peak value n=30 rated value 	3.5 A
 up to 400 V for current peak value n=30 rated value 	3.5 A
 up to 500 V for current peak value n=30 rated value 	3.6 A
 up to 690 V for current peak value n=30 rated value 	3.3 A
minimum cross-section in main circuit at maximum AC-1 rated value	4 mm²
operational current for approx. 200000 operating cycles at	
AC-4	
• at 400 V rated value	4.1 A
at 690 V rated value	3.3 A
operational current	
at 1 current path at DC-1	
— at 24 V rated value	20 A
— at 60 V rated value	20 A
— at 110 V rated value	2.1 A
— at 220 V rated value	0.8 A
— at 440 V rated value	0.6 A
— at 600 V rated value	0.6 A
with 2 current paths in series at DC-1	
— at 24 V rated value	20 A
— at 60 V rated value	20 A
— at 110 V rated value	12 A
— at 110 V rated value — at 220 V rated value	1.6 A
	0.8 A
— at 440 V rated value	
— at 600 V rated value	0.7 A
with 3 current paths in series at DC-1 at 24 V rated value.	20.4
— at 24 V rated value	20 A
— at 60 V rated value	20 A
— at 110 V rated value	20 A
— at 220 V rated value	20 A
— at 440 V rated value	1.3 A
— at 600 V rated value	1 A
 at 1 current path at DC-3 at DC-5 	

at 24 V rated value at 110 V rated value at 24 V rated value at 100 V rated value at 200 V rated value at 400 V rated value at 500 V rated value at 50		
- at 110 V rated value	— at 24 V rated value	20 A
• with 2 current paths in series at DC-3 at DC-5 — at 24 V rated value — at 01 V rated value — at 110 V rated value — at 24 V rated value — at 24 V rated value — at 24 V rated value — at 20 V rated value — at 40 V rated value — at 600 V rated value — at 600 V rated value • at AC-3 — at 230 V rated value • at AC-3 — at 230 V rated value • at AC-3 — at 230 V rated value • at AC-3 — at 230 V rated value • at AC-3 — at 230 V rated value • at AC-3 — at 230 V rated value • at AC-3 — at 230 V rated value — at 660 V rated value — at 660 V rated value — at 660 V rated value • at 660 V rated value — at 660 V rated value • at	— at 60 V rated value	0.5 A
	— at 110 V rated value	0.15 A
	 with 2 current paths in series at DC-3 at DC-5 	
### with 3 current paths in series at DC-3 at DC-5 ### at 24 V rated value ### at 60 V rated value ### at 400 V rated value ### at 60 V rated value ### at 40 V rated value ### at 60 V rated value ### at 40 V rated value ### at 40 V rated value ### at 60 V rated	— at 24 V rated value	20 A
• with 3 current paths in series at DC-3 at DC-5 — at 24 V rated value — at 60 V rated value — at 110 V rated value — at 20 V rated value — at 20 V rated value — at 400 V rated value — at 600 V rated value — at 600 V rated value — at 600 V rated value • at AC-2 at 400 V rated value • at AC-2 at 400 V rated value — at 400 V rated value — at 400 V rated value — at 500 V rated value — at 600 V rated value manue — at 600 V rated value — at 600 V rated value — at 600 V rated value — at 600 V rated val	— at 60 V rated value	5 A
at 24 V rated value	— at 110 V rated value	0.35 A
at 24 V rated value	with 3 current paths in series at DC-3 at DC-5	
at 60 V rated value at 110 V rated value at 220 V rated value at 220 V rated value at 440 V rated value at 440 V rated value at 600 V rated value at 400 V rated value at 400 V rated value at 400 V rated value at 890 V rated value at 400 V rated value at 400 V rated value at 890 V rated value at 400 V rated value at 890 V rated value at 8		20 A
Operating power		
operating power at AC-2 at 400 V rated value at AC-3 — at 230 V rated value — at 400 V rated value — at 690 V rated value — at 690 V rated value — at 690 V rated value — at 400 V rated value — at 690 V rated value 2 kW sea 690 V roccurrent peak value n=20 rated value septomating apparent power at AC-8a septomating apparent power app		
at AC-2 at 400 V rated value at AC-3 al AC-3 al AC-3 al AC-3 al AC-3 al 400 V rated value al 400 V rated value al 690 V rated value al 690 V rated value al 690 V rated value al 400 V rated value al 690 V roted value al 690 V rot current peak value n=20 rated value al 690 V rot current peak value n=20 rated value al 690 V for current peak value n=20 rated value al 690 V for current peak value n=30 rated value al 600 V for current peak value n=30 rated value al 600 V for current peak value n=30 rated value al 900 V for current peak value n=30 rated value al 900 V for current peak value n=30 rated value al 600 V for current peak value n=30 rated value al 600 V for current peak value n=30 rated value al 600 V for current peak value n=30 rated value al 600 V for current peak value n=30 rated value al 600 V for current peak value n=30 rated value al 600 V for current peak value n=30 rated value al 600 V for current peak value n=30 rated value al 600 V for current peak value n=30 rated value al 600 V for current peak value n=30 rated value al 600 V for current peak value n=30 rated value al 600 V for current peak value n=30 rated value al 600 V for current peak value n=30 rated value al 600 V for current peak value n=30 rated value al 600 V for current peak value n=30 rated value al 600 V for current peak value		0.2 A
■ at 230 V rated value — at 400 V rated value — at 690 V rated value — at 690 V rated value ■ at 800 V rated value ■ at AC-3e — at 230 V rated value ■ at 400 V rated value — at 400 V rated value — at 500 V rated value — at 690 V rated value ■ up to 230 V for current peak value n=20 rated value ■ up to 500 V for current peak value n=20 rated value ■ up to 500 V for current peak value n=20 rated value ■ up to 500 V for current peak value n=20 rated value ■ up to 500 V for current peak value n=30 rated value ■ up to 230 V for current peak value n=30 rated value ■ up to 500 V for current peak value n=30 rated value ■ up to 500 V for current peak value n=30 rated value ■ up to 500 V for current peak value n=30 rated value ■ up to 500 V for current peak value n=30 rated value ■ up to 500 V for current peak value n=30 rated value ■ up to 500 V for current peak value n=30 rated value ■ up to 500 V for current peak value n=30 rated value ■ up to 500 V for current peak value n=30 rated value ■ up to 500 V for current peak value n=30 rated value ■ up to 500 V for current peak value n=30 rated value ■ up to 500 V for current peak value n=30 rated value ■ to 500 V for current peak value n=30 rated value ■ up to 500 V for current peak value n=30 rated value ■ to 500 V for current peak value n=30 rated value ■ to 500 V for current peak value n=30 rated value ■ to 500 V for current peak value n=30 rated value ■ to 500 V for current peak value n=30 rated value ■ to 500 V for current peak value n=30 rated value ■ to 500 V for current peak va		4 134/
- at 230 V rated value - at 400 V rated value - at 590 V rated value - at 690 V rated value - at 690 V rated value - at 500 V rated value - at 400 V rated value - at 400 V rated value - at 500 V rated value - at 500 V rated value - at 500 V rated value - at 690 V rated value - 2 kW - at 690 V rated value - 2 kW - operating apparent power at AC-5a - up to 230 V for current peak value n=20 rated value - up to 500 V for current peak value n=20 rated value - up to 690 V for current peak value n=20 rated value - up to 690 V for current peak value n=20 rated value - up to 500 V for current peak value n=20 rated value - up to 500 V for current peak value n=30 rated value - up to 500 V for current peak value n=30 rated value - up to 500 V for current peak value n=30 rated value - up to 500 V for current peak value n=30 rated value - up to 500 V for current peak value n=30 rated value - up to 500 V for current peak value n=30 rated value - up to 500 V for current peak value n=30 rated value - up to 500 V for current peak value n=30 rated value - up to 500 V for current peak value n=30 rated value - up to 500 V for current peak value n=30 rated value - up to 600 V for current peak value n=30 rated value - up to 600 V for current peak value n=30 rated value - up to 600 V for current peak value n=30 rated value - up to 600 V for current peak value n=30 rated value - up to 600 V for current peak value n=30 rated value - up to 600 V for current peak value n=30 rated value - up to 600 V for current peak value n=30 rated value - up to 600 V for current peak value n=30 rated value - up to 600 V for current peak value n=30 rated value - up to 600 V for current peak value n=30 rated value - up to 600 V for current peak value n=50 rated value - up to 600 V for current peak value n=50 rated value - up to 600 V for current peak value n=50 rated value -		4 KVV
- at 400 V rated value - at 500 V rated value - at 690 V rated value • at AC-3e - at 230 V rated value - at 500 V rated value - at 690 V rated value • up to 230 V for current peak value n=20 rated value • up to 400 V for current peak value n=20 rated value • up to 500 V for current peak value n=20 rated value • up to 500 V for current peak value n=20 rated value • up to 500 V for current peak value n=20 rated value • up to 500 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • up to 600 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • up to 500 V for current peak value n=50 rated value • up to 500 V for current peak value n=50 rated value • up to 500 V f		
- at 500 V rated value - at 800 V rated value • at AC-3e - at 230 V rated value - at 400 V rated value - at 500 V rated value - at 690 V rated value • at 400 V rated value • at 690 V rated value • up to 400 V for current peak value n=20 rated value • up to 500 V for current peak value n=20 rated value • up to 500 V for current peak value n=20 rated value • up to 690 V for current peak value n=20 rated value • up to 690 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • up to 600 V for current peak value n=30 rated value • up to 600 V for current peak value n=30 rated value • up to 600 V for current peak value n=30 rated value • up to 600 V for current peak value n=30 rated value • up to 600 V for current peak value n=30 rated value • up to 600 V for current peak value n=30 rated value • up to 600 V for current peak value n=30 rated value • up to 600 V for current peak value n=30 rated value • timited to 1 s switching at zero current maximum • limited to 1 s switching at zero current maximum • limited to 5 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to		
- at 690 V rated value - at 400 V rated value - at 400 V rated value - at 500 V rated value - at 690 V rated value - at 600 V rated value - at 6		
at AC-3e — at 230 V rated value — at 500 V rated value — at 500 V rated value — at 690 V rated value operating power for approx. 200000 operating cycles at AC-4 at 400 V rated value at 690 V rated value 2 kW 2.5 kW operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value iup to 500 V for current peak value n=30 rated value iup to 500 V for current peak value n=30 rated value iup to 500 V for current peak value n=30 rated value ilimited to 1 s switching at zero current maximum ilimited to 1 s switching at zero current maximum ilimited to 30 s switching at zero current maximum ilimited to 50 s switching at zero current maximum ilimited to 60 s switching at zero current maximum ilimited to 60 s switching at zero current maximum ilimited to 60 s switching at zero current maximum ilimited to 60 s switching at zero current maximum ilimited to 60 s switching at zero current maximum ilimited to 60 s switching at zero current maximum ilimited to 60 s switching at zero current maximum ilimited to 60 s switching at zero current maximum ilimited to 60 s switching at zero current maximum ilimited to 60 s switching at zero current maximum ilimited to 60 s switching at zero current maximum ilimited to 60 s switching at zero current maximum ilimited to 60 s switching at zero current maximum ilimited to 60 s switching at zero current maximum ilimited to 60 s switching at zero current maximum ilimited to 60 s switching at zero current maximum ilimited to 60 s swi	— at 500 V rated value	4 kW
- at 230 V rated value - at 400 V rated value - at 500 V rated value - at 690 V rated value - 2 kW - up to 230 V for current peak value n=20 rated value - up to 500 V for current peak value n=20 rated value - up to 690 V for current peak value n=20 rated value - up to 690 V for current peak value n=20 rated value - up to 400 V for current peak value n=20 rated value - up to 400 V for current peak value n=30 rated value - up to 400 V for current peak value n=30 rated value - up to 500 V for current peak value n=30 rated value - up to 690 V for current peak value n=30 rated value - up to 690 V for current peak value n=30 rated value - up to 690 V for current peak value n=30 rated value - up to 690 V for current peak value n=30 rated value - up to 690 V for current peak value n=30 rated value - up to 690 V for current peak value n=30 rated value - up to 690 V for current peak value n=30 rated value - up to 690 V for current peak value n=30 rated value - up to 690 V for current peak value n=30 rated value - up to 690 V for current peak value n=30 rated value - up to 690 V for current peak value n=30 rated value - up to 690 V for current peak value n=30 rated value - up to 690 V for current peak value n=30 rated value - up to 690 V for current peak value n=30 rated value - up to 690 V for current peak value n=30 rated value - up to 690 V for current peak value n=30 rated value - up to 690 V for current peak value n=30 rated value - up to 690 V for current peak value n=30 rated value - up to 690 V for current peak value n=30 rated value - up to 590 V for current peak value n=30 rated value - up to 690 V for current peak value n=30 rated value - up to 690 V for current peak value n=30 rated value - up to 690 V for current peak value n=30 rated value - up to 690 V for current peak value n=30 r	— at 690 V rated value	5.5 kW
- at 400 V rated value - at 500 V rated value - at 690 V rated value 5 kW operating power for approx. 200000 operating cycles at AC-4 • at 400 V rated value • at 690 V rated value • up to 230 V for current peak value n=20 rated value • up to 400 V for current peak value n=20 rated value • up to 500 V for current peak value n=20 rated value • up to 690 V for current peak value n=20 rated value • up to 690 V for current peak value n=20 rated value • up to 230 V for current peak value n=30 rated value • up to 400 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • up to 690 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • limited to 1 s switching at zero current maximum • limited to 5 s switching at zero current maximum • limited to 5 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current	• at AC-3e	
- at 500 V rated value - at 690 V rated value operating power for approx. 200000 operating cycles at AC-4 • at 400 V rated value • at 690 V rated value • up to 230 V for current peak value n=20 rated value • up to 400 V for current peak value n=20 rated value • up to 500 V for current peak value n=20 rated value • up to 690 V for current peak value n=20 rated value • up to 690 V for current peak value n=30 rated value • up to 230 V for current peak value n=30 rated value • up to 400 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • up to 690 V for current peak value n=30 rated value • up to 690 V for current peak value n=30 rated value • up to 690 V for current peak value n=30 rated value • limited to 1 s switching at zero current maximum • limited to 5 s switching at zero current maximum • limited to 50 s switching at zero current maximum • limited to 10 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 switching at zero current maximum • limited to 60 switching at zero current maximum • limited to 60 switching at zero current maximum • limited to 60 switching at zero current maximum • limited to 60 switching at zero current maximum	— at 230 V rated value	2.2 kW
- at 690 V rated value operating power for approx. 200000 operating cycles at AC-4 • at 400 V rated value • at 690 V rated value • at 690 V rocurrent peak value n=20 rated value • up to 230 V for current peak value n=20 rated value • up to 500 V for current peak value n=20 rated value • up to 500 V for current peak value n=20 rated value • up to 690 V for current peak value n=20 rated value • up to 500 V for current peak value n=20 rated value • up to 690 V for current peak value n=30 rated value • up to 400 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • up to 690 V for current peak value n=30 rated value • up to 690 V for current peak value n=30 rated value • up to 690 V for current peak value n=30 rated value • up to 690 V for current peak value n=30 rated value • up to 690 V for current peak value n=30 rated value • limited to 1 s switching at zero current maximum • limited to 10 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching frequency • at AC operating frequency • at AC-1 maximum • at AC-2 maximum 1 000 1/h 750 1/h	— at 400 V rated value	4 kW
operating power for approx. 200000 operating cycles at AC-4 • at 400 V rated value • at 690 V rated value • up to 230 V for current peak value n=20 rated value • up to 400 V for current peak value n=20 rated value • up to 500 V for current peak value n=20 rated value • up to 690 V for current peak value n=20 rated value • up to 690 V for current peak value n=20 rated value • up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a • up to 230 V for current peak value n=30 rated value • up to 400 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • up to 690 V for current peak value n=30 rated value • up to 690 V for current peak value n=30 rated value • up to 690 V for current peak value n=30 rated value • up to 690 V for current peak value n=30 rated value • thin the switching at zero current maximum • limited to 1 s switching at zero current maximum • limited to 5 s switching at zero current maximum • limited to 10 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching frequency • at AC operating frequency • at AC-1 maximum • at AC-2 maximum 1 000 1/h 750 1/h	— at 500 V rated value	4 kW
at 400 V rated value at 690 V rated value 2 kW operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value short-time withstand current in cold operating state up to 40 °C ilimited to 1 s switching at zero current maximum limited to 10 s switching at zero current maximum limited to 10 s switching at zero current maximum limited to 10 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum shifted to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum shifted to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switchi	— at 690 V rated value	5 kW
at 400 V rated value at 690 V rated value 2 kW operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value 4 kVA short-time withstand current in cold operating state up to 40 °C limited to 1 s switching at zero current maximum limited to 10 s switching at zero current maximum limited to 30 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum shifted to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum olimited to 60 s switching at zero current maximum shifted to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum shifted to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum shifted to 60 s switching at zero current maximum shifted to 60 s switching at zero current maximum shifted to 60 s switching at zero current maximum shifted to 60 s switching at zero current maximum shifted to 60 s switching at zero current maximum shifted to 60 s switching at zero current maximum shifted to 60 s switching at zero current maximum shifted to 60 s switching at zero current maximum shifted to 60 s switching at zero current maximum shifted to 60 s switching at zero	operating power for approx. 200000 operating cycles at AC-	
a at 690 V rated value operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 230 V for current peak value n=20 rated value 5.9 kVA operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value 4 kVA oup to 690 V for current peak value n=30 rated value limited to 1 s switching at zero current maximum limited to 10 s switching at zero current maximum limited to 10 s switching at zero current maximum limited to 30 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum shifted to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum shifted to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum shifted to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum shifted to 60 s switching at zero current maximum shifted to 60 s switching at zero current maximum shifted to 60 s switching at zero current maximum shifted to 60 s switching at zero current maximum shifted to 60 s switching at zero current maximum shifted to 60 s switching at zero current maximum shifted to 60 s switching at zero current maximum shifted to 60 s switching at zero current maximum shifted to 60 s switching at zero current maximum shifted to 60 s switching at zero current maximum shifted to 60 s switching at zero current maximum shifted to 60 s switching at zero current maximum shifted to 60	4	
operating apparent power at AC-6a • up to 230 V for current peak value n=20 rated value • up to 400 V for current peak value n=20 rated value • up to 500 V for current peak value n=20 rated value • up to 690 V for current peak value n=20 rated value • up to 230 V for current peak value n=20 rated value • up to 230 V for current peak value n=30 rated value • up to 230 V for current peak value n=30 rated value • up to 400 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • up to 690 V for current peak value n=30 rated value • up to 690 V for current peak value n=30 rated value • up to 690 V for current peak value n=30 rated value • limited to 1 s switching at zero current maximum • limited to 5 s switching at zero current maximum • limited to 10 s switching at zero current maximum • limited to 10 s switching at zero current maximum • limited to 6 os switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching	at 400 V rated value	2 kW
• up to 230 V for current peak value n=20 rated value • up to 400 V for current peak value n=20 rated value • up to 500 V for current peak value n=20 rated value • up to 690 V for current peak value n=20 rated value • up to 690 V for current peak value n=30 rated value • up to 230 V for current peak value n=30 rated value • up to 400 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • up to 690 V for current peak value n=30 rated value • up to 690 V for current peak value n=30 rated value • up to 690 V for current peak value n=30 rated value • up to 690 V for current peak value n=30 rated value • up to 690 V for current peak value n=30 rated value • limited to 1 s switching at zero current maximum • limited to 1 s switching at zero current maximum • limited to 1 s switching at zero current maximum • limited to 10 s switching at zero current maximum • limited to 30 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum	at 690 V rated value	2.5 kW
• up to 400 V for current peak value n=20 rated value • up to 500 V for current peak value n=20 rated value • up to 690 V for current peak value n=20 rated value • up to 690 V for current peak value n=30 rated value • up to 230 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • up to 690 V for current peak value n=30 rated value • up to 690 V for current peak value n=30 rated value • up to 690 V for current peak value n=30 rated value • limited to 1 s switching at zero current maximum • limited to 5 s switching at zero current maximum • limited to 10 s switching at zero current maximum • limited to 10 s switching at zero current maximum • limited to 30 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limit	operating apparent power at AC-6a	
• up to 500 V for current peak value n=20 rated value • up to 690 V for current peak value n=20 rated value • up to 230 V for current peak value n=30 rated value • up to 400 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • up to 690 V for current peak value n=30 rated value • up to 690 V for current peak value n=30 rated value • up to 690 V for current peak value n=30 rated value • limited to 1 s switching at zero current maximum • limited to 5 s switching at zero current maximum • limited to 10 s switching at zero current maximum • limited to 30 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited	 up to 230 V for current peak value n=20 rated value 	2 kVA
• up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a • up to 230 V for current peak value n=30 rated value • up to 400 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • up to 690 V for current peak value n=30 rated value • up to 690 V for current peak value n=30 rated value • up to 690 V for current peak value n=30 rated value • limited to 1 s switching at zero current maximum • limited to 5 s switching at zero current maximum • limited to 10 s switching at zero current maximum • limited to 10 s switching at zero current maximum • limited to 30 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • loo 00 1/h operating frequency • at AC 10 000 1/h operating frequency • at AC-1 maximum • at AC-2 maximum 750 1/h	 up to 400 V for current peak value n=20 rated value 	3.6 kVA
operating apparent power at AC-6a • up to 230 V for current peak value n=30 rated value • up to 400 V for current peak value n=30 rated value • up to 500 V for current peak value n=30 rated value • up to 690 V for current peak value n=30 rated value • up to 690 V for current peak value n=30 rated value • limited to 1 s switching at zero current maximum • limited to 5 s switching at zero current maximum • limited to 10 s switching at zero current maximum • limited to 30 s switching at zero current maximum • limited to 30 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero curren	 up to 500 V for current peak value n=20 rated value 	4.6 kVA
up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value short-time withstand current in cold operating state up to 40 °C limited to 1 s switching at zero current maximum limited to 5 s switching at zero current maximum limited to 10 s switching at zero current maximum limited to 30 s switching at zero current maximum limited to 30 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum sharp to 4 kVA 155 A; Use minimum cross-section acc. to AC-1 rated value 66 A; Use minimum cross-section acc. to AC-1 rated value 66 A; Use minimum cross-section acc. to AC-1 rated value 155 A; Use minimum cross-section acc. to AC-1 rated value 155 A; Use minimum cross-section acc. to AC-1 rated value 150 A; Use minimum cross-section acc. to AC-1 rated value 150 A; Use minimum cross-section acc. to AC-1 rated value 150 A; Use minimum cross-section acc. to AC-1 rated value 150 A; Use minimum cross-section acc. to AC-1 rated value 150 A; Use minimum cross-section acc. to AC-1 rated value 150 A; Use minimum cross-section acc. to AC-1 rated value 150 A; Use minimum cross-section acc. to AC-1 rated value 150 A; Use minimum cross-section acc. to AC-1 rated value 150 A; Use minimum cross-section acc. to AC-1 rated value 150 A; Use minimum cross-section acc. to AC-1 rated value 150 A; Use minimum cross-section acc. to AC-1 rated value 150 A; Use minimum cross-section acc. to AC-1 rated value 150 A; Use minimum cross-section acc. to AC-1 rated value 150 A; Use minimum cross-section acc. to AC-1 rated value	 up to 690 V for current peak value n=20 rated value 	5.9 kVA
 up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value 4 kVA short-time withstand current in cold operating state up to 40 °C limited to 1 s switching at zero current maximum limited to 5 s switching at zero current maximum limited to 10 s switching at zero current maximum limited to 30 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum st A; Use minimum cross-section acc. to AC-1 rated value 66 A; Use minimum cross-section acc. to AC-1 rated value 55 A; Use minimum cross-section acc. to AC-1 rated value 10 000 1/h operating frequency at AC-1 maximum at AC-2 maximum 1 000 1/h 750 1/h 	operating apparent power at AC-6a	
 up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value short-time withstand current in cold operating state up to 40 °C limited to 1 s switching at zero current maximum limited to 5 s switching at zero current maximum limited to 10 s switching at zero current maximum limited to 10 s switching at zero current maximum limited to 30 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching frequency at AC 10 000 1/h operating frequency at AC-1 maximum at AC-2 maximum 750 1/h 	• up to 230 V for current peak value n=30 rated value	1.3 kVA
 up to 690 V for current peak value n=30 rated value short-time withstand current in cold operating state up to 40 °C limited to 1 s switching at zero current maximum limited to 5 s switching at zero current maximum limited to 10 s switching at zero current maximum limited to 30 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching frequency at AC operating frequency at AC-1 maximum at AC-2 maximum 4 kVA 5 A; Use minimum cross-section acc. to AC-1 rated value 55 A; Use minimum cross-section acc. to AC-1 rated value 55 A; Use minimum cross-section acc. to AC-1 rated value 55 A; Use minimum cross-section acc. to AC-1 rated value 10 000 1/h 	• up to 400 V for current peak value n=30 rated value	2.4 kVA
short-time withstand current in cold operating state up to 40 °C • limited to 1 s switching at zero current maximum • limited to 5 s switching at zero current maximum • limited to 10 s switching at zero current maximum • limited to 30 s switching at zero current maximum • limited to 30 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum 155 A; Use minimum cross-section acc. to AC-1 rated value 66 A; Use minimum cross-section acc. to AC-1 rated value 55 A; Use minimum cross-section acc. to AC-1 rated value 10 000 1/h	• up to 500 V for current peak value n=30 rated value	3.1 kVA
short-time withstand current in cold operating state up to 40 °C • limited to 1 s switching at zero current maximum • limited to 5 s switching at zero current maximum • limited to 10 s switching at zero current maximum • limited to 30 s switching at zero current maximum • limited to 30 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum 10 000 1/h • at AC-1 maximum • at AC-2 maximum 10 000 1/h 750 1/h	up to 690 V for current peak value n=30 rated value	4 kVA
• limited to 1 s switching at zero current maximum • limited to 5 s switching at zero current maximum • limited to 10 s switching at zero current maximum • limited to 30 s switching at zero current maximum • limited to 30 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum • limited to 60 s switching at zero current maximum for A; Use minimum cross-section acc. to AC-1 rated value 66 A; Use minimum cross-section acc. to AC-1 rated value 55 A; Use minimum cross-section acc. to AC-1 rated value 10 000 1/h operating frequency • at AC-1 maximum 1 000 1/h • at AC-2 maximum 750 1/h		
 limited to 5 s switching at zero current maximum limited to 10 s switching at zero current maximum limited to 30 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum mo-load switching frequency at AC at AC-1 maximum at AC-2 maximum 1000 1/h 1000 1/h 1000 1/h 		
 limited to 10 s switching at zero current maximum limited to 30 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum A; Use minimum cross-section acc. to AC-1 rated value A; Use minimum cross-section acc. to AC-1 rated value A; Use minimum cross-section acc. to AC-1 rated value A; Use minimum cross-section acc. to AC-1 rated value A; Use minimum cross-section acc. to AC-1 rated value A; Use minimum cross-section acc. to AC-1 rated value A; Use minimum cross-section acc. to AC-1 rated value A; Use minimum cross-section acc. to AC-1 rated value A; Use minimum cross-section acc. to AC-1 rated value A; Use minimum cross-section acc. to AC-1 rated value A; Use minimum cross-section acc. to AC-1 rated value A; Use minimum cross-section acc. to AC-1 rated value A; Use minimum cross-section acc. to AC-1 rated value A; Use minimum cross-section acc. to AC-1 rated value A; Use minimum cross-section acc. to AC-1 rated value A; Use minimum cross-section acc. to AC-1 rated value A; Use minimum cross-section acc. to AC-1 rated value A; Use minimum cross-section acc. to AC-1 rated value A; Use minimum cross-section acc. to AC-1 rated value A; Use minimum cross-section acc. to AC-1 rated value A; Use minimum cross-section acc. to AC-1 rated value A; Use minimum cross-section acc. to AC-1 rated value A; Use minimum cross-section acc. to AC-1 rated value A; Use minimum cross-section acc. to AC-1 rated value A; Use minimum cross-section acc. to AC-1 rated value A; Use minimum cross-section acc. to AC-1 rated value A; Use minimum cross-section acc. to AC	 limited to 1 s switching at zero current maximum 	155 A; Use minimum cross-section acc. to AC-1 rated value
 limited to 30 s switching at zero current maximum limited to 60 s switching at zero current maximum To 400 1/h A; Use minimum cross-section acc. to AC-1 rated value A; Use minimum cross-section acc. to AC-1 rated value AC-1 rate	 limited to 5 s switching at zero current maximum 	111 A; Use minimum cross-section acc. to AC-1 rated value
 limited to 60 s switching at zero current maximum no-load switching frequency at AC operating frequency at AC-1 maximum at AC-2 maximum 1000 1/h 750 1/h 	 limited to 10 s switching at zero current maximum 	86 A; Use minimum cross-section acc. to AC-1 rated value
no-load switching frequency 10 000 1/h operating frequency at AC-1 maximum 1 000 1/h o at AC-2 maximum 750 1/h	 limited to 30 s switching at zero current maximum 	66 A; Use minimum cross-section acc. to AC-1 rated value
 at AC operating frequency at AC-1 maximum at AC-2 maximum 750 1/h 	 limited to 60 s switching at zero current maximum 	55 A; Use minimum cross-section acc. to AC-1 rated value
● at AC 10 000 1/h operating frequency ● at AC-1 maximum 1 000 1/h ● at AC-2 maximum 750 1/h	no-load switching frequency	
 at AC-1 maximum at AC-2 maximum 1 000 1/h 750 1/h 	• at AC	10 000 1/h
 at AC-1 maximum at AC-2 maximum 1 000 1/h 750 1/h 	operating frequency	
• at AC-2 maximum 750 1/h		1 000 1/h
▼ at 70-5 illa\lilliiii	at AC-3 maximum	750 1/h
• at AC-3e maximum 750 1/h		
• at AC-4 maximum 250 1/h		
Control circuit/ Control		200 m
		۸۲
type of voltage of the control supply voltage AC		AU .
control supply voltage at AC		220 1/
• at 50 Hz rated value 220 V		
• at 60 Hz rated value 240 V		240 V
operating range factor control supply voltage rated value of magnet coil at AC	operating range factor control supply voltage rated value of	

● at 50 Hz	0.8 1.1
● at 60 Hz	0.8 1.1
apparent pick-up power of magnet coil at AC	
• at 50 Hz	26.4 VA
● at 60 Hz	26.4 VA
inductive power factor with closing power of the coil	
● at 50 Hz	0.81
• at 60 Hz	0.81
apparent holding power of magnet coil at AC	
● at 50 Hz	4.4 VA
● at 60 Hz	4.4 VA
inductive power factor with the holding power of the coil	
● at 50 Hz	0.24
• at 60 Hz	0.24
closing delay	
• at AC	9 35 ms
opening delay	
• at AC	4 15 ms
arcing time	10 15 ms
control version of the switch operating mechanism	Standard A1 - A2
Auxiliary circuit	
number of NC contacts for auxiliary contacts instantaneous	1
contact	
operational current at AC-12 maximum	10 A
operational current at AC-15	
• at 230 V rated value	10 A
 at 400 V rated value 	3 A
• at 500 V rated value	2 A
at 690 V rated value	1 A
operational current at DC-12	
• at 24 V rated value	10 A
• at 48 V rated value	6 A
• at 60 V rated value	6 A
 at 110 V rated value 	3 A
at 125 V rated value	2 A
 at 220 V rated value 	1 A
at 600 V rated value	0.15 A
operational current at DC-13	
at 24 V rated value	10 A
• at 48 V rated value	2 A
• at 60 V rated value	2 A
• at 110 V rated value	1 A
• at 125 V rated value	0.9 A
• at 220 V rated value	0.3 A
at 600 V rated value	0.1 A
contact reliability of auxiliary contacts	1 faulty switching per 100 million (17 V, 1 mA)
UL/CSA ratings	
full-load current (FLA) for 3-phase AC motor	
• at 480 V rated value	7.6 A
at 600 V rated value	9 A
yielded mechanical performance [hp]	
• for single-phase AC motor	
— at 110/120 V rated value	0.33 hp
— at 230 V rated value	1 hp
for 3-phase AC motor	
— at 200/208 V rated value	2 hp
— at 220/206 V rated value — at 220/230 V rated value	3 hp
— at 460/480 V rated value	5 hp
— at 575/600 V rated value	7.5 hp
contact rating of auxiliary contacts according to UL	A600 / Q600
Short-circuit protection	

design of the fuse link	
 for short-circuit protection of the main circuit 	
 — with type of coordination 1 required 	gG: 35A (690V,100kA), aM: 20A (690V,100kA), BS88: 35A (415V,80kA)
 — with type of assignment 2 required 	gG: 20A (690V,100kA), aM: 16A (690V, 100kA), BS88: 20A (415V, 80kA)
for short-circuit protection of the auxiliary switch required	gG: 10 A (500 V, 1 kA)
nstallation/ mounting/ dimensions	
mounting position	+/-180° rotation possible on vertical mounting surface; can be tilted forward and backward by +/- 22.5° on vertical mounting surface
fastening method	screw and snap-on mounting onto 35 mm DIN rail according to DIN EN 60715
side-by-side mounting	Yes
height	58 mm
width	45 mm
depth	73 mm
required spacing	70 11111
with side-by-side mounting	
— forwards	10 mm
— upwards	10 mm
— downwards	10 mm
— at the side	0 mm
• for grounded parts	
— forwards	10 mm
— upwards	10 mm
— at the side	6 mm
— downwards	10 mm
for live parts	
— forwards	10 mm
— upwards	10 mm
— downwards	10 mm
— at the side	6 mm
Connections/ Terminals	· · · · · · · · · · · · · · · · · · ·
type of electrical connection	
for main current circuit	screw-type terminals
for auxiliary and control circuit	screw-type terminals
at contactor for auxiliary contacts	Screw-type terminals
of magnet coil	Screw-type terminals
type of connectable conductor cross-sections for main contacts	7,50
• solid	2x (0.5 1.5 mm²), 2x (0.75 2.5 mm²), 2x 4 mm²
solid or stranded	2x (0,5 1,5 mm²), 2x (0,75 2,5 mm²), 2x 4 mm²
finely stranded with core end processing	2x (0.5 1.5 mm²), 2x (0.75 2.5 mm²)
connectable conductor cross-section for main contacts	
• solid	0.5 4 mm²
stranded	0.5 4 mm²
finely stranded with core end processing	0.5 2.5 mm²
connectable conductor cross-section for auxiliary contacts	
solid or stranded	0.5 4 mm²
finely stranded with core end processing	0.5 2.5 mm²
type of connectable conductor cross-sections	
for auxiliary contacts	
— solid or stranded	2x (0.5 1.5 mm²), 2x (0.75 2.5 mm²), 2x 4 mm²
 finely stranded with core end processing 	2x (0.5 1.5 mm²), 2x (0.75 2.5 mm²)
for AWG cables for auxiliary contacts	2x (20 16), 2x (18 14), 2x 12
AWG number as coded connectable conductor cross	
section	
• for main contacts	20 12
for auxiliary contacts	20 12
Safety related data	
product function	
	Yes
product function • mirror contact according to IEC 60947-4-1 B10 value with high demand rate according to SN 31920	Yes 1 000 000
mirror contact according to IEC 60947-4-1	

 with high demand rate according to SN 31920 	73 %
failure rate [FIT] with low demand rate according to SN 31920	100 FIT
T1 value for proof test interval or service life according to IEC 61508	20 a
protection class IP on the front according to IEC 60529	IP20
touch protection on the front according to IEC 60529	finger-safe, for vertical contact from the front
suitability for use	
 safety-related switching OFF 	Yes
Contification of annual la	

Certificates/ approvals

General Product Approval





Confirmation



<u>KC</u>



EMC

Functional Safety/Safety of Machinery

Declaration of Conformity

Test Certificates



Type Examination Certificate





Special Test Certificate

Type Test Certificates/Test Report

Marine / Shipping





Confirmation









Marine / Shipping

other



Confirmation

Vibration and Shock

Railway

Environmental Confirmations

Environment

Further information

Siemens has decided to exit the Russian market (see here).

https://press.siemens.com/global/en/pressrelease/siemens-wind-down-russian-business

Siemens is working on the renewal of the current EAC certificates.

Please contact your local Siemens office on the status of validity of the EAC certification if you intend to import or offer to supply these products to an EAC relevant market (other than the sanctioned EAEU member states Russia or Belarus).

Information on the packaging

https://support.industry.siemens.com/cs/ww/en/view/109813875

Information- and Downloadcenter (Catalogs, Brochures,...)

https://www.siemens.com/ic10

Industry Mall (Online ordering system)

https://mall.industry.siemens.com/mall/en/en/Catalog/product?mlfb=3RT2016-1AP62

Cax online generator

 $\underline{\text{http://support.automation.siemens.com/WW/CAXorder/default.aspx?lang=en\&mlfb=3RT2016-1AP62}$

 $Service \& Support \ (Manuals, \ Certificates, \ Characteristics, \ FAQs, ...)$

https://support.industry.siemens.com/cs/ww/en/ps/3RT2016-1AP62

Image database (product images, 2D dimension drawings, 3D models, device circuit diagrams, EPLAN macros, ...)


http://www.automation.siemens.com/bilddb/cax_de.aspx?mlfb=3RT2016-1AP62&lang=en


Characteristic: Tripping characteristics, I²t, Let-through current


https://support.industry.siemens.com/cs/ww/en/ps/3RT2016-1AP62/char


Further characteristics (e.g. electrical endurance, switching frequency)


http://www.automation.siemens.com/bilddb/index.aspx?view=Search&mlfb=3RT2016-1AP62&objecttype=14&gridview=view1







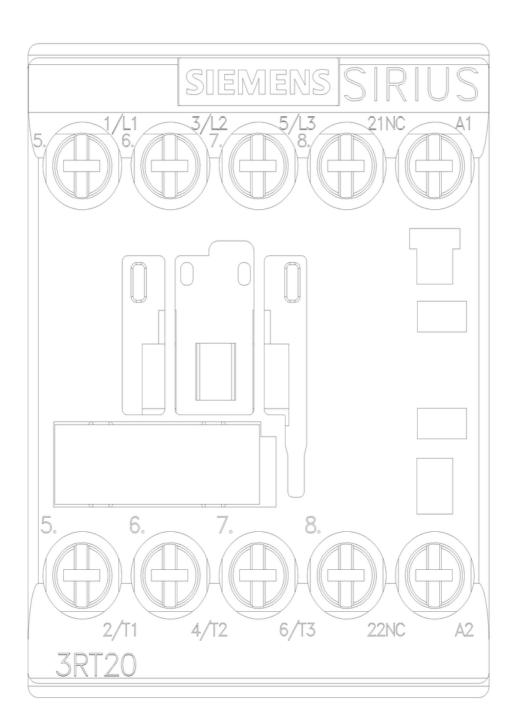

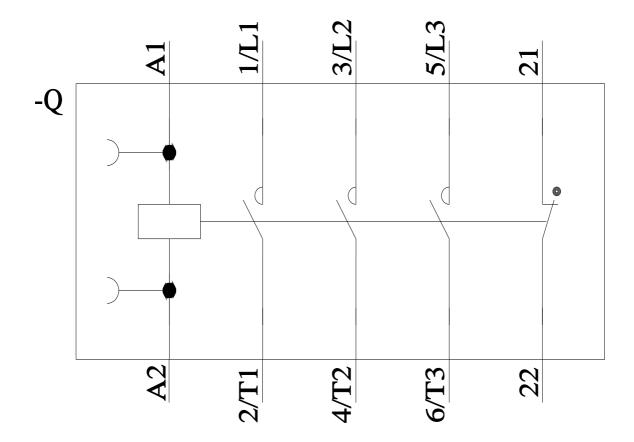

last modified: 2/10/2023 🖸